


Electrical Boundaries Diagram Plan 20

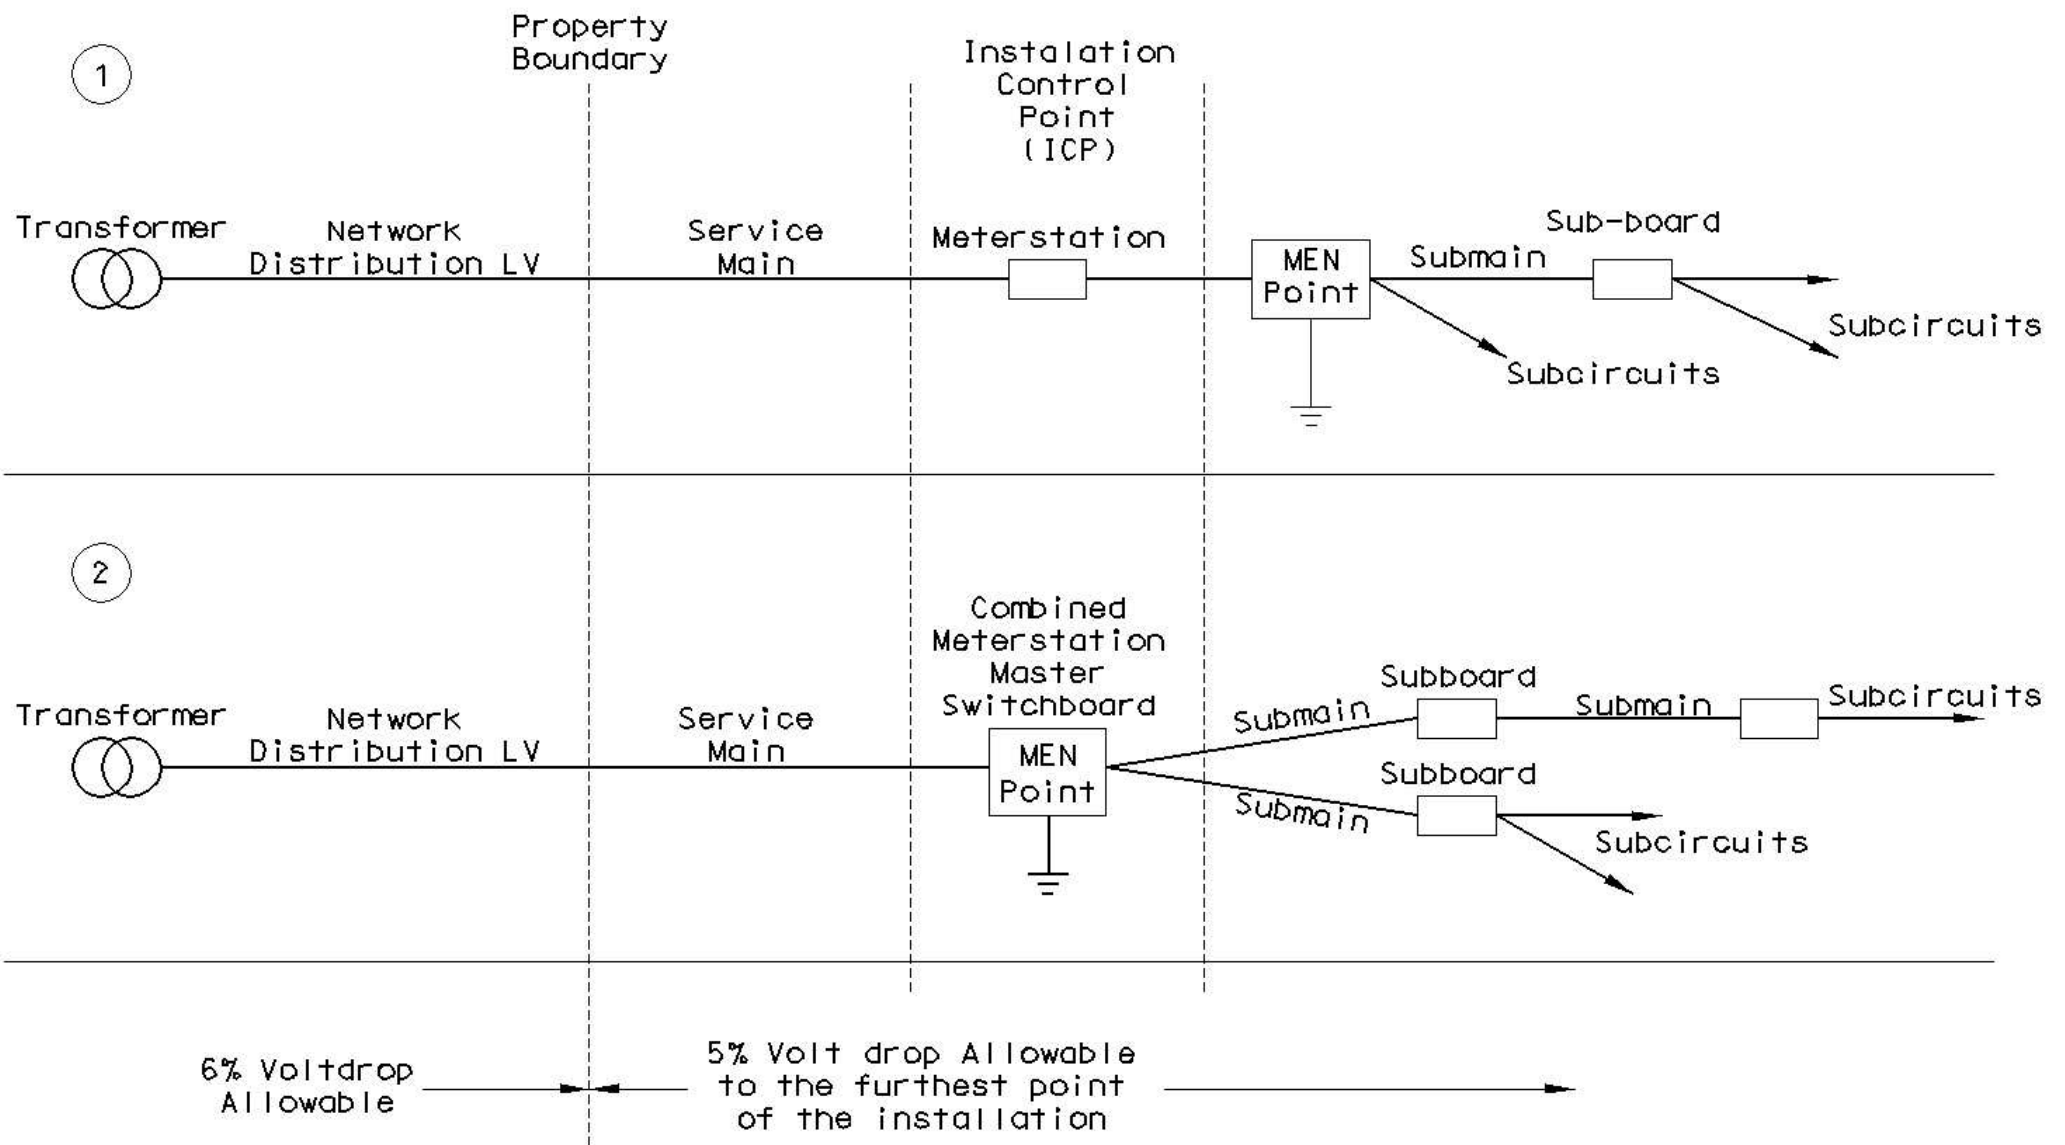

Note – Good engineering design will allow for not greater than 6% voltage drop at the meter terminals. (distribution & Service Mains) However, for designs which are outside this recommendation, but compliant with the regulations, these designs should be advised to the customer in writing.

Northpower <small>M.B. Giddard BE HIRIANG Chief Executive</small>	Rev	Amendments	By	Checked	Date	Electrical Boundaries	Drawn	C. Parkes	Date	18/01/05	
	B	correct spelling	SP	C.W.	25/10/05		Checked	R. Watson	Date	5/07/05	
Head Office 28 Mt Pleasant Road Private Bag 9018 Telephone 0-9-430 1803 Facsimile 0-9-430 1804 http://www.northpower.co.nz						Approved	S. Love	Date	5/07/05		
						Issue	B	Date	25/10/05		
							Plan Number	2G228s15			
							Scale	M5	Sheet size	A4	